XPass 2

INSTALLATION GUIDE

Version 1.09

English
EN 101.00.XP2

suprema
SECURITY & BIOMETRICS

CONTENTS

Safety Instructions 4

Compliance Information 4

Getting Started 8

Components 8

Name and function of each part 9

Installation 12

Fixing the bracket and the product 12

Power supply connection 16

Network Connection 17

Input connection 18

Relay Connection 19

Connecting as a Standalone 21

Connecting to Secure I/O 2 23

Wiegand Connection 24

Initialize Network Settings 24

Factory default 25

Product Specifications 26

Credentials 26

General 26

Capacity 27

Interface 27

Electrical 28

Dimensions and Weight 29

Regulatory Information 31

FCC Compliance Information 31

IC information 32

EU Declaration of Conformity (CE) 32

Appendices 33

Disclaimers 33

Copyright Notice 34

Open Source License 34

Safety Instructions

Please read this safety instructions before you use the product to prevent injury to yourself and others and to prevent property damage.

The term ‘product’ in this manual refers to the product and any items provided with the product.

Compliance Information

Warning

Used to indicate warning information that could lead to serious injury or death if violated while using the product.

Caution

Used to indicate caution information that may result in minor injury or product damage if violated while using the product.

Info

Used to provide notes or additional information while using the product.

Note

Used to provide notes or additional information while using the product.

⚠ Warning

Install

Be especially careful of miswiring when using high-capacity power supplies.

- Serious fires, electric shocks, or product damage may occur due to miswiring.

Do not allow users to install or repair the product arbitrarily.

- Causes fire, electric shock, or injury.
- No free repair service will be provided if the product is damaged due to arbitrary installation or repair by the user.

Do not install the product in places exposed to direct sunlight, moisture, dust, or soot, or where gas may leak.

- May cause fire or electric shock.

When installing the product outdoors, make sure to install it in a shaded and well-ventilated area.

Do not use a completely sealed enclosure when installing the product outdoors.

- The internal temperature of the enclosure may rise due to direct sunlight, causing fire, electric shock, or product damage.

Do not install the product in places where heat is generated, such as near heaters.

- May cause fire or electric shock due to overheating.

Do not install in damp places.

- May cause electric shock or product damage due to moisture.

Do not install in places with electromagnetic interference.

- May cause electric shock or product damage.

Usage

Do not allow liquids such as water, beverages, or chemicals to enter the product.

- May cause fire, electric shock, or product damage.

Do not use damaged power adapters or plugs, or loose outlets.

- If connections are unstable, may cause fire or electric shock.

Do not bend or break the power cord excessively.

- May cause fire or electric shock.

⚠ Caution

Install

Read this manual carefully before installing the product to ensure safe and correct installation.

When wiring power cables and connectors, make sure to turn off the power to all devices you are connecting before wiring and connecting.

- Devices may malfunction.

Before connecting the power to the product, check the manual again to ensure that wiring is correct, then connect the power.

Do not install the product in places directly exposed to sunlight or ultraviolet light.

- May cause product damage, malfunction, discoloration, or deformation.

Do not leave power cables in passageways.

- May cause bodily injury or product damage.

Do not install near strong magnetic objects such as magnets, TVs, CRT monitors, or speakers.

- The device may malfunction.

When installing the product on a wall, do not seal around the product with silicone or similar materials.

- The device may malfunction.

When installing multiple devices, ensure the minimum spacing distance is observed.

- May affect the RF and BLE performance of other devices, causing them to malfunction.

Use a power adapter that has IEC/EN 62368-1 approval and is rated above the power consumption of the terminal device. It is recommended to use the power adapters sold by Suprema.

- Using an unsuitable power supply may cause devices to malfunction.
- Refer to the Power in the product specifications for maximum current consumption specifications.

Ensure that the product and Secure I/O 2, electric lock (electronic locking device) use separate power supplies.

- Devices may malfunction.

Do not connect the power supply and PoE power together.

- Devices may malfunction.

It is recommended to use an enclosure when installed outdoors with full exposure.

- Decreased waterproof and dustproof performance may cause malfunction.

Usage

Do not drop or subject the product to shock.

- The device may malfunction.

Ensure the power supply is not interrupted during firmware upgrades of the product.

- The device may malfunction.

Manage the password so others do not know it, and change it regularly.

- This may lead to unauthorized access.

Do not press the product's buttons (touchpad) forcefully or use sharp tools to press them.

- The device may malfunction.

Use the product within -35 °C ~ 65 °C and store it at appropriate temperatures, not too low or too high.

- The device may malfunction.

Be careful when cleaning the product.

- Gently wipe the product surface with a clean, dry cloth.
- If disinfecting the product, dampen a clean cloth with a suitable amount of disinfectant alcohol and gently wipe the product surface. Use disinfectant alcohol that contains 70-75% isopropyl alcohol and a clean, lint-free soft cloth.
- Do not spray disinfectant directly onto the product.

Do not use the product for purposes other than its intended use.









- The device may malfunction.


> **RTC Battery**
>
> Replacing with unauthorized or incorrect types of batteries may pose a risk of explosion. Dispose of batteries according to local or international waste regulations.

Getting Started

Provides initial procedures for getting started with the device.

Components

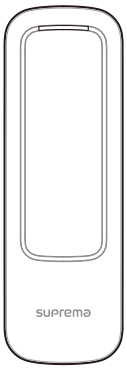
			
XPass 2 Mullion Type (XP2-MDPB, XP2-MAPB, XP2-MAPB-H)	Wall Bracket (XP2-MDPB, XP2-MAPB, XP2-MAPB-H)	XPass 2 Gang Box Type (XP2-GDPB)	Wall Bracket (XP2-GDPB)
			
XPass 2 Keypad Type (XP2-GKDPB)	Wall Bracket (XP2-GKDPB)	Fixing Screws x2	Bracket Fixing Screw (Star Shaped)

				
Diode	120 Ω Resistor	Shrink Tube	Quick Guide	Open Source Software Guide

Info

- Components may vary according to the installation environment.
- When assembling the product with the bracket, you can use the included bracket fixing screw (Star Shaped) instead of the product fixing screw for enhanced security.

Name and function of each part

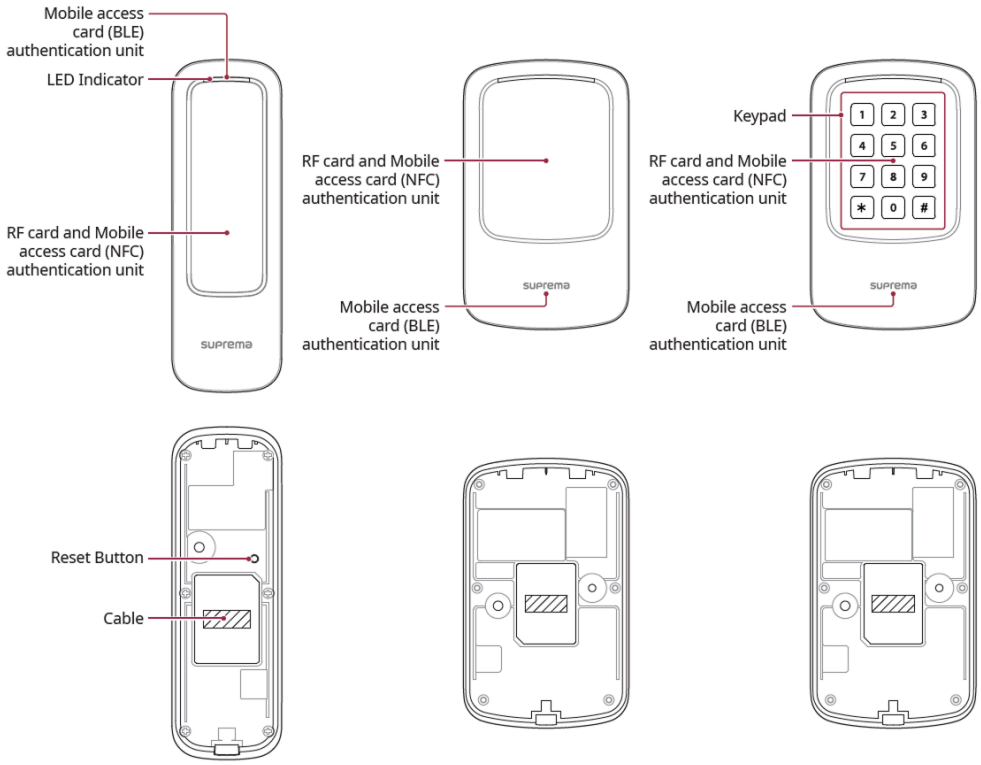

- **LED Indicator**: Indicates the operational status of the device with the color of the LED.
  - Green: Authentication success.
  - Red: Authentication failure.
  - Blue/Cyan blinking: Normal operation.
  - Blue/Green blinking: During network settings initialization
  - Green blinking: Waiting for input.
  - Green/White blinking: Connecting to the Suprema AirFob Pass (BLE) application
  - White blinking: Connecting to the Device Manager application
- **RF card and mobile access card authentication unit**: Part to scan a RFID card or mobile access card for entrance.
- **Mobile Access Card Recognition Area**: This is the part that recognizes mobile access cards for entry.
- **Reset Button**


  - Initializes network settings. For more information on initializing network settings, refer to Initialize Network Settings.
  - Deletes all information and certificates stored on the device and initializes the settings. For more information on factory initialization, refer to Factory default.

- **Cable**


  Power / RS-485 / Ethernet / Wiegand I/O / Input / Relay

- **Keypad**: XP2-GKDPB Used to authenticate by directly entering the Card ID. To authenticate using direct input mode, change the authentication method settings in BioStar X.
  - **0-9**: Used when entering numbers.
  - ✱: Used to distinguish between FC code and ID when entering Wiegand Card ID.
  - #: Used to terminate input.

Cable

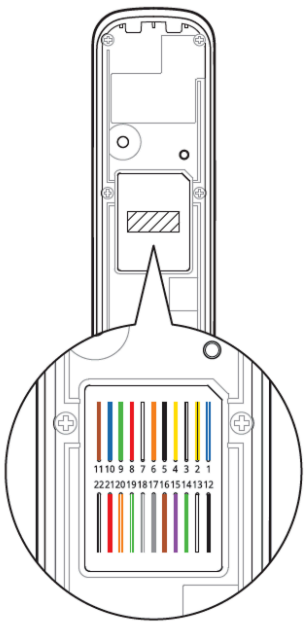

XP2-MDPB, XP2-MAPB, XP2-MAPB-H

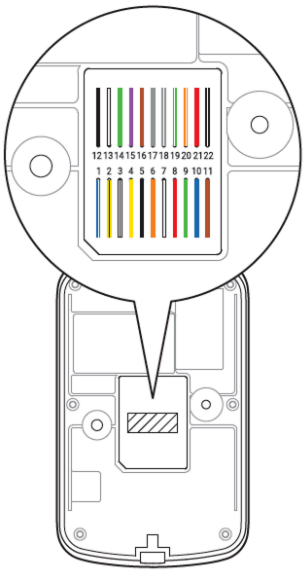

XP2-GDPB, XP2-GKDPB

Pin	Name	Color
1	485 TRXP	Blue (White Stripe)
2	485 TRXN	Yellow (Black Stripe)
3	485 GND	White (Black Stripe)
4	ENET RXN	Yellow
5	ENET RXP	Black
6	ENET TXN	Orange
7	ENET TXP	White
8	ENET VB1	Red
9	ENET VB1	Green
10	ENET VB2	Blue
11	ENET VB2	Brown
12	WG GND	Black
13	WG D1	White
14	WG D0	Green
15	INPUT0	Purple

Pin	Name	Color
16	INPUT1	Brown
17	INPUT GND	Gray
18	RLY NO	Gray (White Stripe)
19	RLY COM	Green (White Stripe)
20	RLY NC	Orange (White Stripe)
21	PWR +VDC	Red
22	PWR GND	Black (White Stripe)


Installation

Provides the complete installation procedures and connection examples required for the device.

Fixing the bracket and the product

> **Info**
> This document explains the installation method based on the million type. Install the gang box type and keypad type in the same way.


1. Secure the bracket tightly using the fixing screws at the location where the product will be mounted.

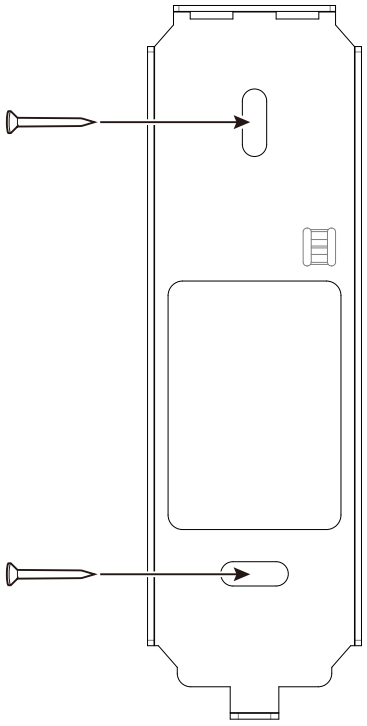


Info

- If installing the product on a concrete wall, drill a hole, insert a PVC anchor, and secure it with a fixing screw.
- To avoid RF interference, a minimum separation distance must be maintained.


XP2-MDPB, XP2-MAPB, XP2-MAPB-H

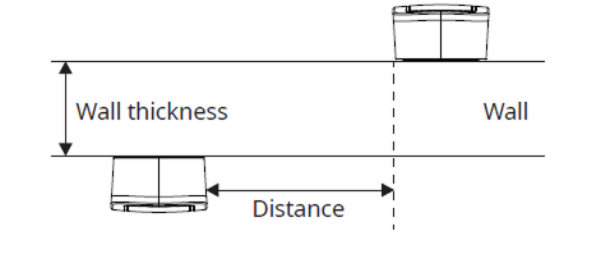


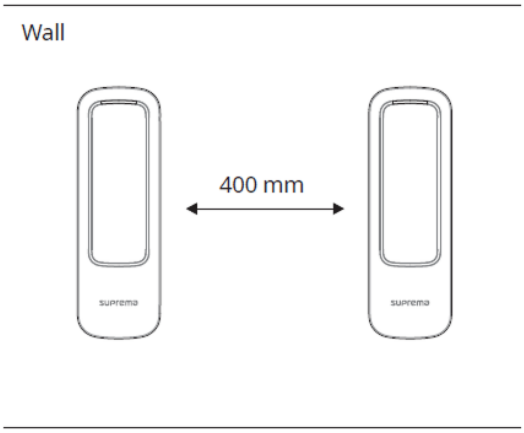

Wall thickness	Distance
100 mm	360 mm
120 mm	360 mm
150 mm	300 mm

XP2-GDPB, XP2-GKDPB

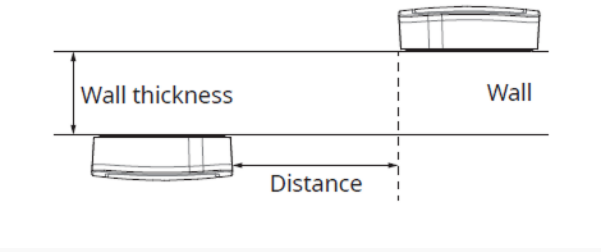


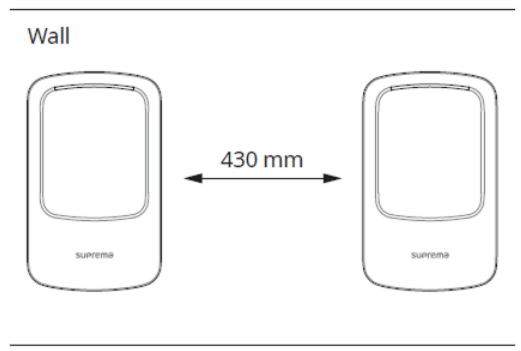

Wall thickness	Distance
100 mm	400 mm
120 mm	380 mm
150 mm	380 mm

- When using a mobile access card, install devices maintaining a minimum distance of 1 m between devices to avoid BLE interference.

2. Mount the product on the fixed bracket.

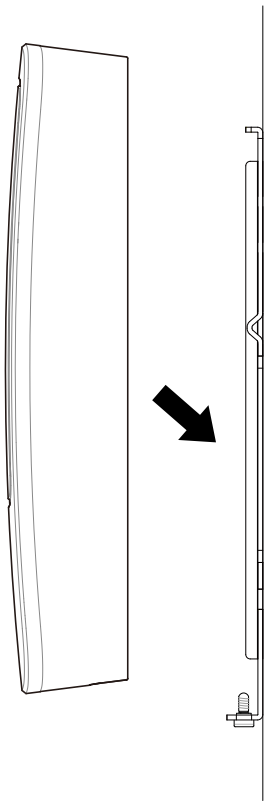


3. Rotate the fixing screws to assemble the product with the bracket.



Info

When assembling the product with the bracket, you can use the included bracket fixing screw (Star Shaped) instead of the product fixing screw for enhanced security.

Power supply connection

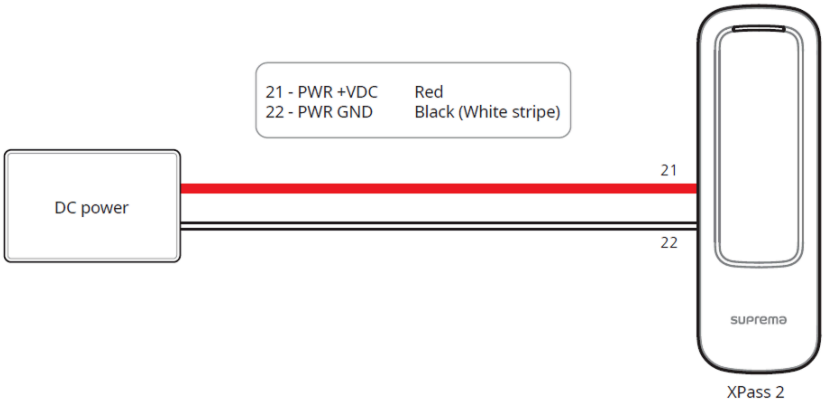

Caution


- Use the IEC/EN 62368-1 approved power adapter that supports higher power consumption than the product. If you wish to connect and use another device to the power supply adapter, you should use an adapter with a current capacity which is the same or larger than the total power consumption required for the terminal and another device.
  - Refer to the Power in the product specifications for maximum current consumption specifications.
- Use a separate power supply for Secure I/O 2, the electric lock, and the product respectively. If connecting and using the power supply to these devices together, the devices may malfunction.
- DO NOT extend the length of power cable when using the power adapter.

Network Connection

TCP/IP

LAN connection (connecting to a hub)

You can connect to the hub using a standard CAT-5e cable.

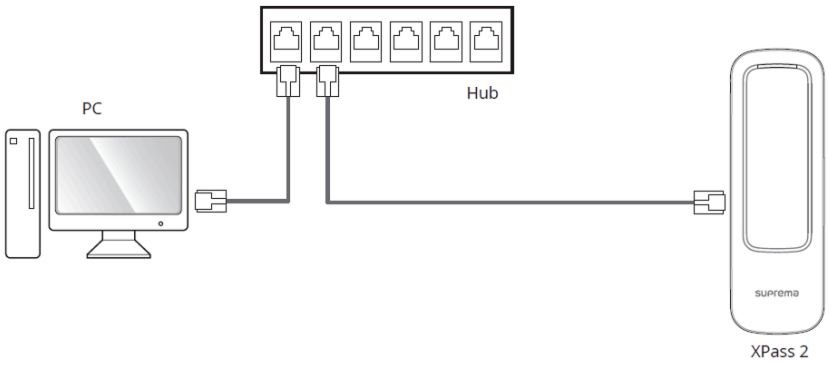

LAN connection (connecting to a PC directly)

This product has automatic MDI/MDIX functionality, so you can connect directly to a PC using a standard CAT-5e cable.



Network ports and services


This device uses the following ports for network communication and stable service operation.

Protocol	Service Description
TCP	Used for communication services between the server and the device, and for the device operation status switching service.
UDP	Used for the device discovery service to search for devices on the network.

Info

These ports are used to provide normal network features of the product. When configuring firewall rules or network security settings, allow the use of these ports.


Input connection

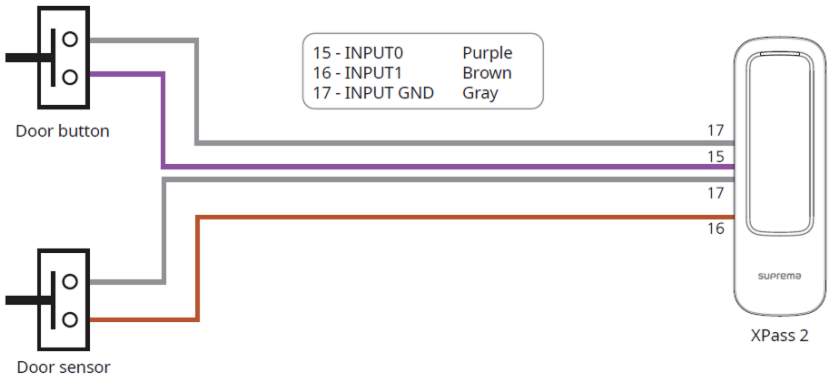

Relay Connection

Fail Safe Lock

In order to use the Fail Safe Lock, connect N/C relay as shown in the figure below. There is normally a current flowing through the relay for the Fail Safe Lock. When the relay is activated, blocking the current flow, the door will open. If the power supply to the product is cut off due to a power failure or an external factor, the door will open.

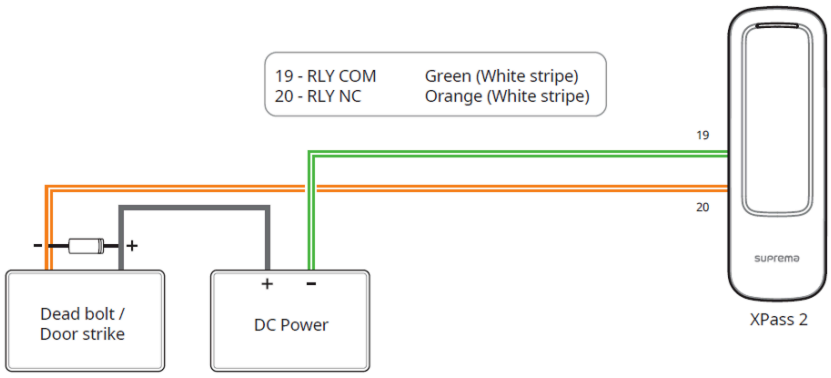

Caution


- Install a diode at both sides of the door lock wire as shown in the figure to protect the relay from the reverse current, which occurs when the door lock operates.
- Use a separate power supply for the product and the door lock.
- Suprema's standalone intelligent readers contain internal relays that can directly lock/unlock doors without external controllers for added convenience. For access control applications in need of security, however, it is NOT recommended to use the internal relay of a reader to prevent any tampering attacks which can potentially trigger the door unlock. For such applications, it is highly recommended to use a separate relay unit for a lock control such as Suprema's Secure I/O 2, DM-20 or CoreStation installed at a secure side of a door.

Info

Take caution of the installation direction of the diode. Install the diode close to the door lock.

Fail Secure Lock

In order to use the Fail Secure Lock, connect N/O relay as shown in the figure below. There is normally no current flowing through the relay for the Fail Secure Lock. When the current flow is activated by the relay, the door will open. If the power supply to the product is cut off due to a power failure or an external factor, the door will lock.

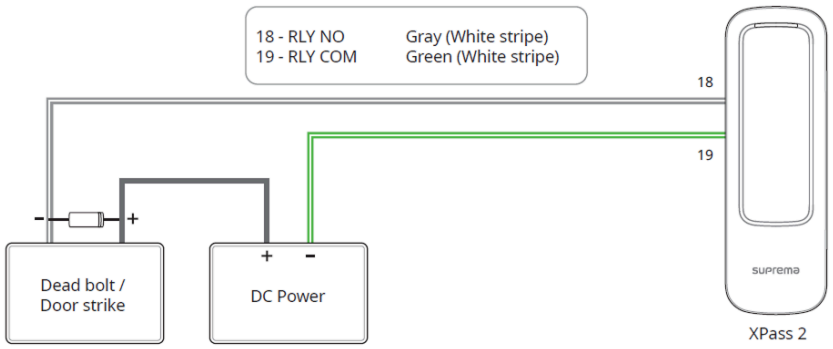


Caution

- Install a diode at both sides of the door lock wire as shown in the figure to protect the relay from the reverse current, which occurs when the door lock operates.
- Use a separate power supply for the product and the door lock.
- Suprema's standalone intelligent readers contain internal relays that can directly lock/unlock doors without external controllers for added convenience. For access control applications in need of security, however, it is NOT recommended to use the internal relay of a reader to prevent any tampering attacks which can potentially trigger the door unlock. For such applications, it is highly recommended to use a separate relay unit for a lock control such as Suprema's Secure I/O 2, DM-20 or CoreStation installed at a secure side of a door.

Info


Take caution of the installation direction of the diode. Install the diode close to the door lock.

Automatic door connection

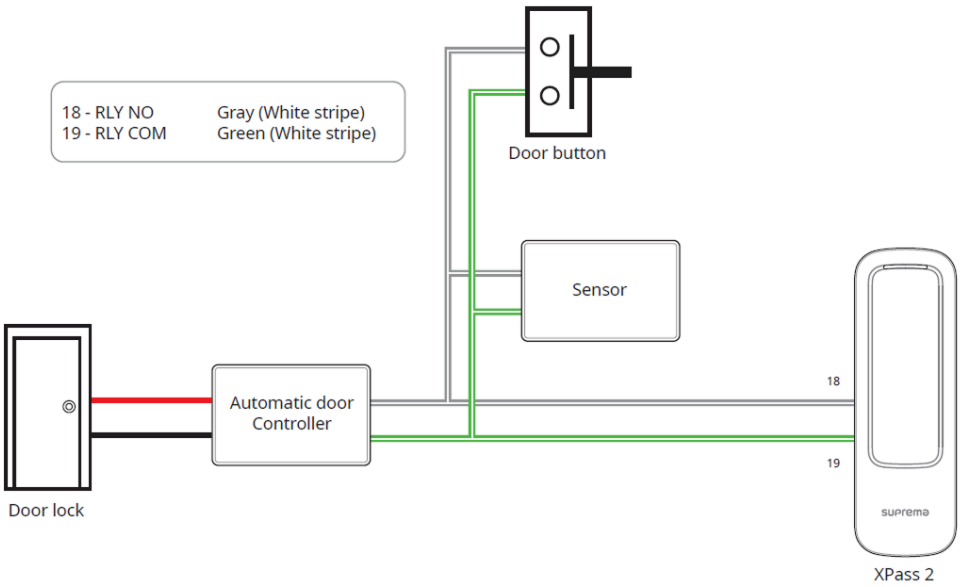

Connecting as a Standalone

The product can be connected to the door lock, door button, and door sensor directly without connecting a separate I/O device.

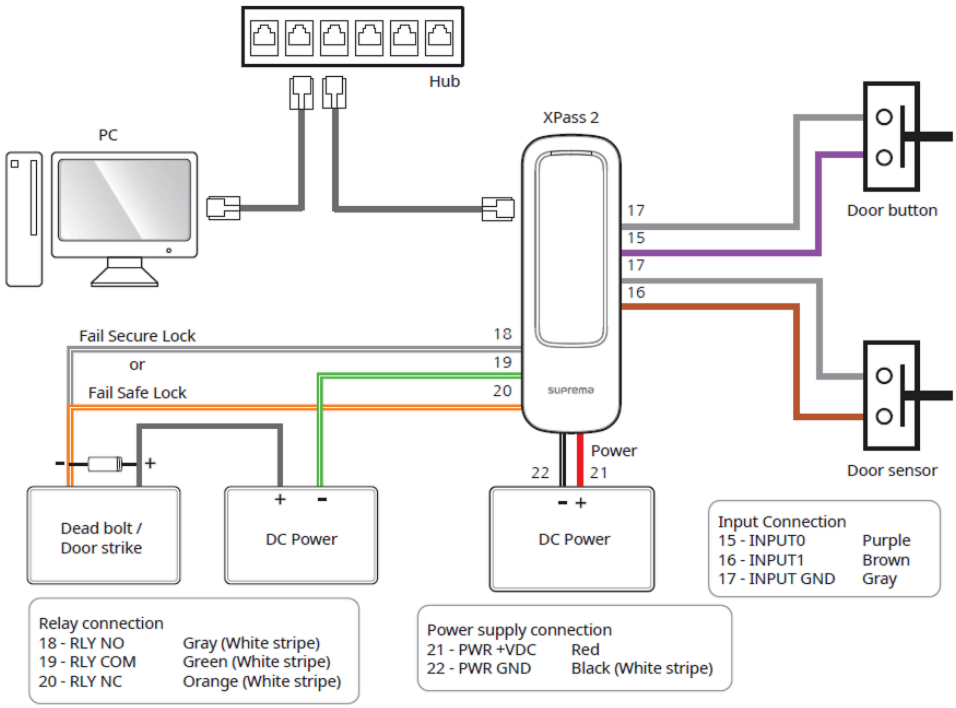

Caution

Suprema's standalone intelligent readers contain internal relays that can directly lock/unlock doors without external controllers for added convenience. For access control applications in need of security, however, it is NOT recommended to use the internal relay of a reader to prevent any tampering attacks which can potentially trigger the door unlock. For such applications, it is highly recommended to use a separate relay unit for a lock control such as Suprema's Secure I/O 2, DM-20 or CoreStation installed at a secure side of a door.


Info

- The device can be used as a multi-door controller with the slave devices with the RS-485 cable. The slave devices are used as dummy readers and authentication is performed in the master device.
- If you use this product as the master device, the slave device can only use card authentication.
- Connect up to 31 slave devices to a master device.
- For more information, contact the Suprema Technical Support Team.

Connecting to Secure I/O 2

Secure I/O 2 is an I/O device, can be connected to the product with the RS-485 cable. Security can be maintained even if the connection between the product and Secure I/O 2 has been lost or the power supply to the product has been shut off due to external factors.

- Use an AWG24 twisted pair with a maximum length of 1.2 km for the RS-485 cable.
- It is recommended to use RS-485 cables with a characteristic impedance of 120 Ω.
- If connecting with a RS-485 daisy chain, connect the termination resistor (120 Ω) to both ends of the daisy chain connection. If connected to the middle line, the signal level becomes smaller and the communication performance will deteriorate. Make sure to connect it to both ends of the daisy chain connection.

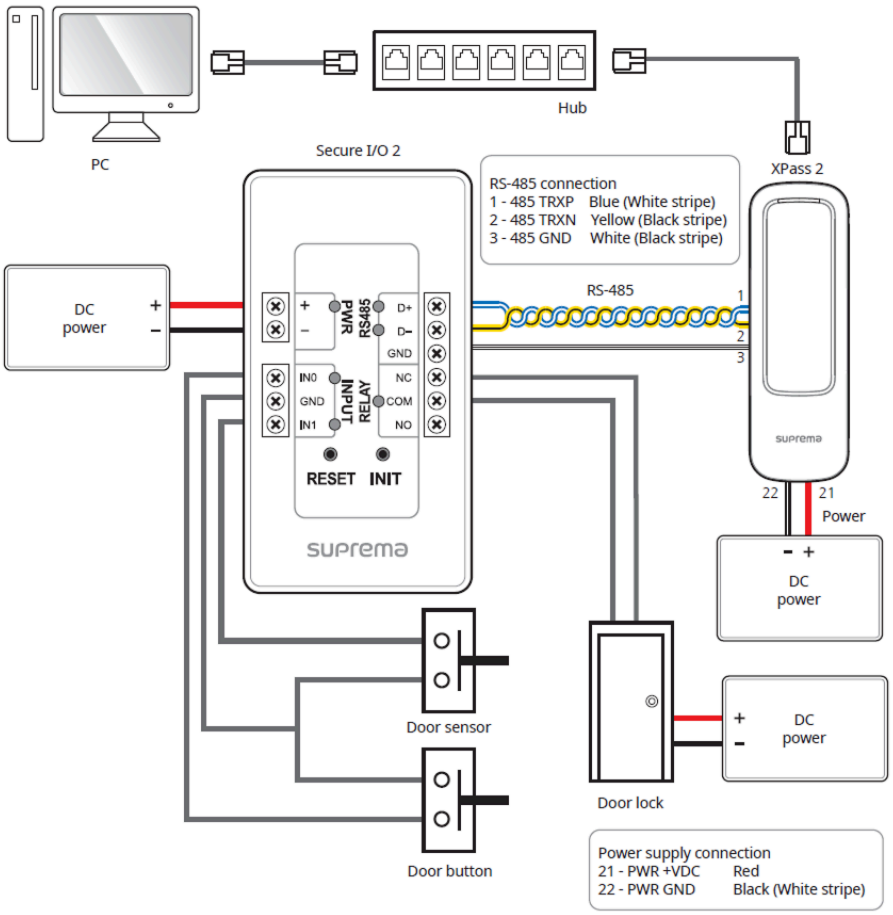


Info

- The device can be used as a multi-door controller with the slave devices with the RS-485 cable. The slave devices are used as dummy readers and authentication is performed in the master device.
- If you use this product as the master device, the slave device can only use card authentication.
- Connect up to 31 slave devices to a master device.
- For more information, contact the Suprema Technical Support Team.

Wiegand Connection

Use as a Wiegand input or output device.

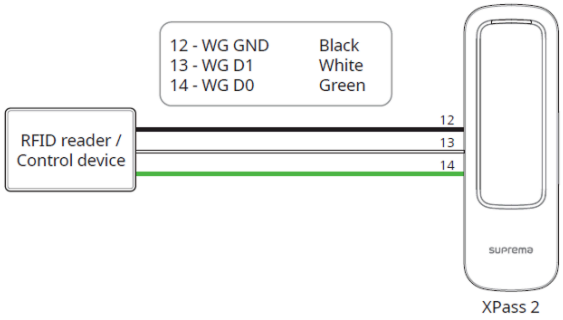

Initialize Network Settings


Initialize the device's network settings.

1. Power on.
2. Press the reset button until the device automatically reboots.
3. Connect the device using the initialized network information.
    - **TCP/IP Address**: DHCP address assignment (if DHCP address assignment fails, will be set to 169.254.x.x).
    - **Server Mode**: Disable
    - **RS-485**: Default, 115200 bps
4. Change the TCP/IP or RS-485 information.
5. Check if the network information is correctly set after turning the power off and on.

Factory default

Delete all information stored on the device and initialize the settings.

1. Power on.
2. Quickly press the reset button three times.

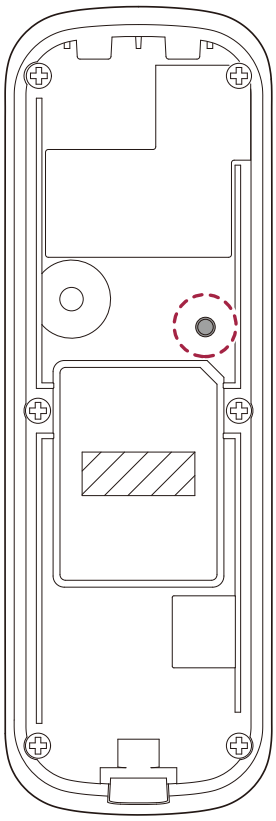

3. Press the reset button once more when the device's LED blinks green.

Info

You can only use Factory Default when the root certificate is stored on the device.

Product Specifications

Provides key specifications of the product, including size, features, and performance.

Credentials

RF Card	**XP2-MDPB, XP2-GDPB, XP2-GKDPB**	**125kHz EM & 13.56MHz MIFARE, MIFARE Plus, DESFire, DESFire EV1/EV2/EV3, FeliCa**
	XP2-MAPB	**125kHz EM, HID Prox & 13.56MHz MIFARE, MIFARE Plus, DESFire, DESFire EV1/EV2/EV3, FeliCa, iCLASS SE/SR/Seos**
	XP2-MAPB-H	**125kHz EM, HID Prox & 13.56MHz iCLASS SE/SR/Seos**
RF Read Range[1)]	**EM/MIFARE/DESFire/HID iCLASS: 50 mm, HID Prox/FeliCa: 30 mm**	
Mobile	**NFC, BLE**	

General

CPU	**1 GHz**
Memory	**4 GB Flash + 64 MB RAM**
Crypto Chip	**Supported**
LED	**Multi-color**
Sound	**Multi-tone Buzzer**
Operating Temperature	**-35 °C ~ 65 °C**
Storage Temperature	**-40 °C ~ 70 °C**
Operating Humidity	**0 % ~ 95 %, non-condensing**
Storage Humidity	**0 % ~ 95 %, non-condensing**

IP Rating	**IP65, IP67**	
IK Rating	**IK08**	
Authentication	**XP2-MDPB, XP2-GDPB**	**CE, UKCA, KC, FCC, IC, RCM, BIS, SIG, RoHS, REACH, WEEE**
	XP2-GKDPB	**CE, UKCA, KC, FCC, IC, RCM, BIS, SIG, TELEC, RoHS, REACH, WEEE**
	XP2-MAPB, XP2-MAPB-H	**CE, UKCA, KC, FCC, RCM, SIG, RoHS, REACH, WEEE**

Capacity

Max. User	**200,000**
Max. Card	**200,000**
Max. Text logs	**1,000,000**

Interface

Ethernet	**Supported (10/100 Mbps, auto MDI/MDI-X)**
Network Protocol	**TCP, UDP**
RS-485	**1 ch Master / Slave (Selectable)**
RS-485 Communication Protocol	**OSDP V2 compliant**
Wiegand	**1 ch Input / 1 ch Output (Selectable)**
Input	**2 ch Inputs**
Relay	**1 relay**


PoE	**Supported (IEEE 802.3af compliant)**
Tamper	**Supported**

Electrical

Power	**12 Vdc**	**Current: Max. 0.5 A**
	24 Vdc	**Current: Max. 0.3 A**
Switch Input VIH	• **Min.: 3 V** • **Max.: 5 V**	
Switch Input VIL	**Max.: 1 V**	
Switch Pull-up Resistance	**4.7 kΩ (The input ports are pulled up with 4.7 kΩ.)**	
Wiegand Output VOH	**More than 4.8 V**	
Wiegand Output VOL	**Less than 0.2 V**	
Wiegand Output Pull-up Resistance	**Internally pulled up with 1 kΩ**	
Relay	• **2 A @ 30 VDC Resistive load** • **1 A @ 30 VDC Inductive load**	

Dimensions and Weight


XP2-MDPB, XP2-MAPB, XP2-MAPB-H

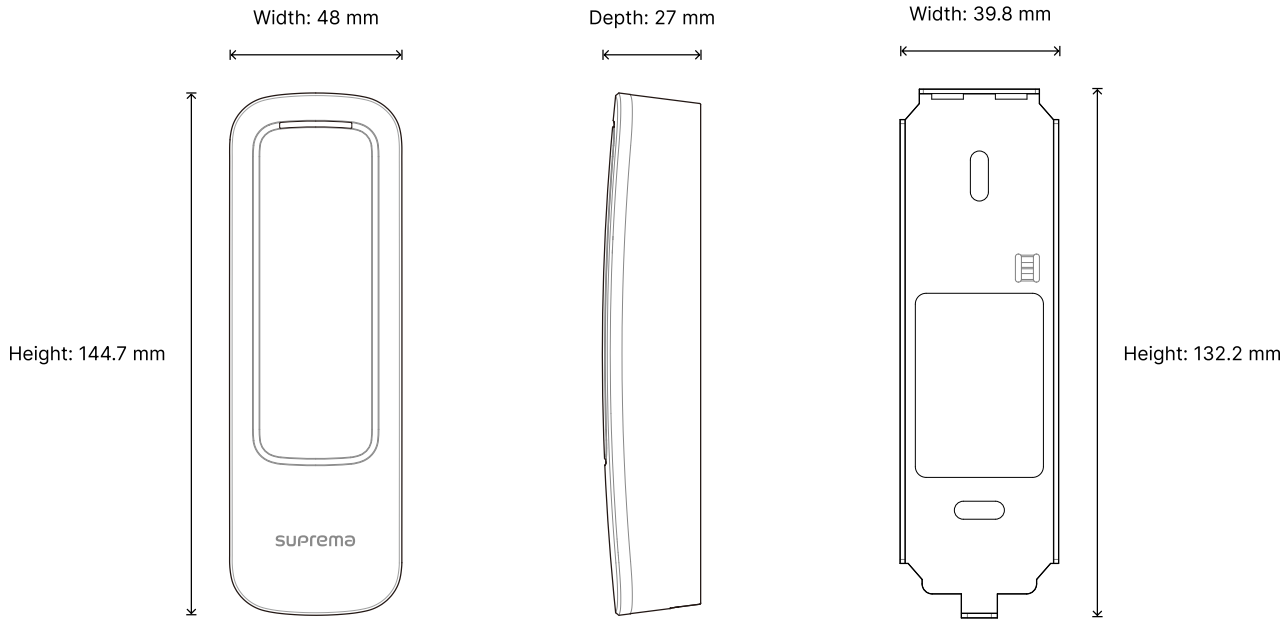

Weight: 144 g

Weight: 30 g
(Including washer and bolt)

XP2-GDPB, XP2-GKDPB

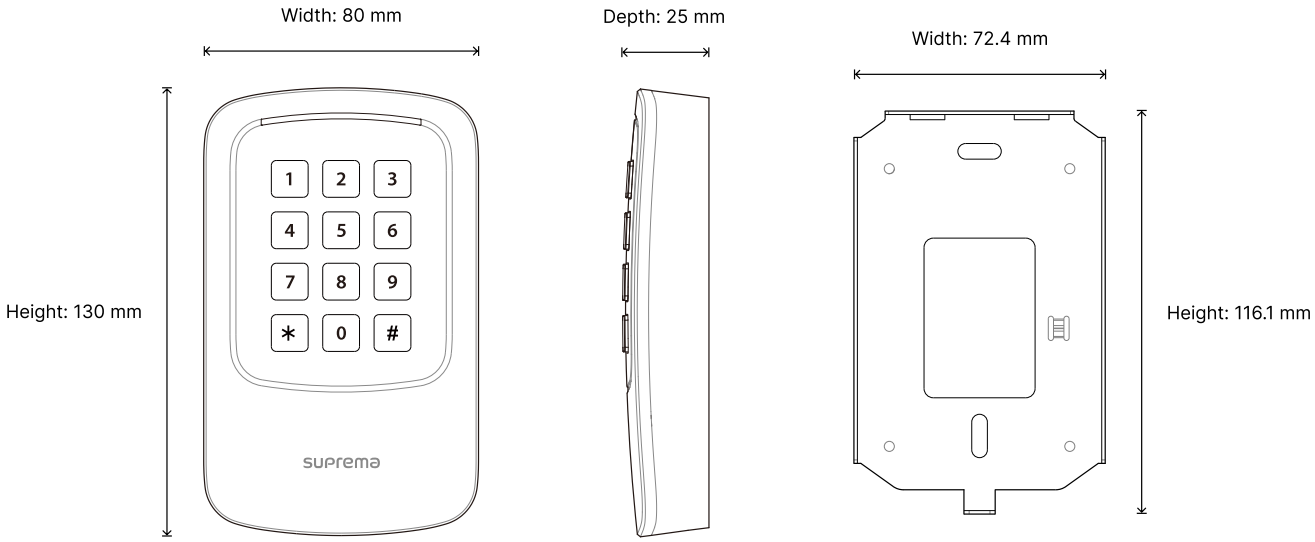

Weight
- XP2-GDPB: 220 g
- XP2-GKDPB: 235 g

Weight: 52 g
(Including washer and bolt)

---

1) The RF detection range may vary depending on the installation environment.

Info

Product specifications are subject to change without notice for performance improvement.

Regulatory Information

Provides information on regulations and certifications complied with by the product.

FCC Compliance Information

THIS DEVICE COMPLIES WITH PART 15 OF THE FCC RULES.

Operation is subject to the following two conditions:

1. This device may not cause harmful interference, and
2. This device must accept any interference received, including interference that may cause undesired operation.

Info

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

Any changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate this equipment.

This transmitter must not be co-located or operating in conjunction with any other antenna or transmitter.

This equipment complies with FCC radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance 20 cm between the radiator and your body. Do not install or operate this device and its antenna in conjunction with any other antenna or RF transmission device.

IC information

This device complies with Industry Canada's licence-exempt RSSs.

Operation is subject to the following two conditions:

1. This device may not cause interference; and
2. This device must accept any interference, including interference that may cause undesired operation of the device.

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts de licence.

L'exploitation est autorisée aux deux conditions suivantes :

1. l'appareil ne doit pas produire de brouillage ;
2. l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

EU Declaration of Conformity (CE)

This product is CE marked according to the provisions of the Radio Equipment Directive (RED) 2014/53/EU.

Hereby, Suprema Inc. declares that this product is in compliance with the essential requirements and other relevant provisions of Radio Equipment Directive (RED) 2014/53/EU and is marked with the CE mark. This device is a Class 1 radio device according to the instructions.

- Bluetooth transmit power: 2.1 dBm
- Bluetooth frequency: 2402~2480 MHz
- NFC frequency: 13.56 MHz
- RFID frequency: 13.56 MHz + 125 kHz

For more information, please contact us via the contact details below.

Suprema Inc.

Address: 17F Parkview Tower, 248, Jeongjail-ro, Bundang- gu, Seongnam-si, Gyeonggi-do, 13554, Rep. of KOREA

Tel: +82-31-783-4502 / Fax: +82-31-783-4503

Appendices

Includes legal notices contained in the product.

Disclaimers

- Information in this web site is provided in connection with Suprema products.
- The right to use is acknowledged only for Suprema products included in the terms and conditions of use or sale for such products guaranteed by Suprema. No license, express or implied, by estoppel or otherwise, to any intellectual property is granted by this web site.
- Except as expressly stated in an agreement between you and Suprema, Suprema assumes no liability whatsoever, and Suprema disclaims all warranties, express or implied including, without limitation, relating to fitness for a particular purpose, merchantability, or noninfringement.
- All warranties are VOID if Suprema products have been: 1) improperly installed or where the serial numbers, warranty date or quality assurance decals on the hardware are altered or removed; 2) used in a manner other than as authorized by Suprema; 3) modified, altered or repaired by a party other than Suprema or a party authorized by Suprema; or 4) operated or maintained in unsuitable environmental conditions.
- Suprema products are not intended for use in medical, lifesaving, life-sustaining applications, or other applications in which the failure of the Suprema product could create a situation where personal injury or death may occur. Should you purchase or use Suprema products for any such unintended or unauthorized application, you shall indemnify and hold Suprema and its officers, employees, subsidiaries, affiliates, and distributors harmless against all claims, costs, damages, and expenses, and reasonable attorney fees arising out of, directly or indirectly, any claim of personal injury or death associated with such unintended or unauthorized use, even if such claim alleges that Suprema was negligent regarding the design or manufacture of the part.
- Suprema reserves the right to make changes to specifications and product descriptions at any time without notice to improve reliability, function, or design.
- Personal information, in the form of authentication messages and other relative information, may be stored within Suprema products during usage. Suprema does not take responsibility for any information, including personal information, stored within Suprema’s products that are not within Suprema’s direct control or as stated by the relevant terms and conditions. When any stored information, including personal information, is used, it is the responsibility of the product users to comply with national legislation (such as GDPR) and to ensure proper handling and processing.
- You must not rely on the absence or characteristics of any features or instructions marked "reserved" or "undefined." Suprema reserves these for future definition and shall have no responsibility whatsoever for conflicts or incompatibilities arising from future changes to them.
- Except as expressly set forth herein, to the maximum extent permitted by law, the Suprema products are sold "as is".
- Contact your local Suprema sales office or your distributor to obtain the latest specifications and before placing your product order.

Copyright Notice

The copyright for this website is owned by Suprema. Rights to other product names, trademarks, and registered trademarks belong to the respective individuals or organizations that own them.

Open Source License

- The software for this product is created by modifying version 3.x of the Linux kernel, and the license for the Linux kernel follows the GPL. For more information about the GPL license, see the GNU General Public License.
- The glibc library included in this product follows the LGPL. For more information about the LGPL license, see the GNU Lesser General Public License.
- The QT library included in this product follows the LGPL. For more information about the LGPL license, see the GNU Lesser General Public License.
- This product uses the “OpenSSL”, which is licensed under the OpenSSL and Original SSLeay licenses. For more information about the OpenSSL and Original SSLeay licenses, please see the OpenSSL License and Original SSLeay License.
- The source modified based on Linux kernel 3.x, glibc library, and QT library included in this product can be downloaded by contacting the Suprema Technical Support Team.

Suprema Inc.

17F Parkview Tower, 248, Jeongjail-ro, Bundang-gu, Seongnam-si, Gyeonggi-do, 13554, Rep. of KOREA

Tel: +82 31 783 4502 | Fax: +82 31 783 4503 | Inquiry: sales_sys@supremainc.com

For more information about Suprema's global branch offices,
visit the webpage below by scanning the QR code.
https://supremainc.com/en/about/global-office.asp

© 2026 Suprema Inc. Suprema and identifying product names and numbers herein are registered trade marks of Suprema, Inc.
All non-Suprema brands and product names are trademarks or registered trademarks of their respective companies.
Product appearance, build status and/or specifications are subject to change without notice.